

5
ton

TEREX PEINER SK 56


CORLEONIS



Zeskanuj kod
i pobierz kartę na telefon




DIN 15018	H1 / B3
BGL 2125	0071
Udźwąg maksymalny	5.0 t

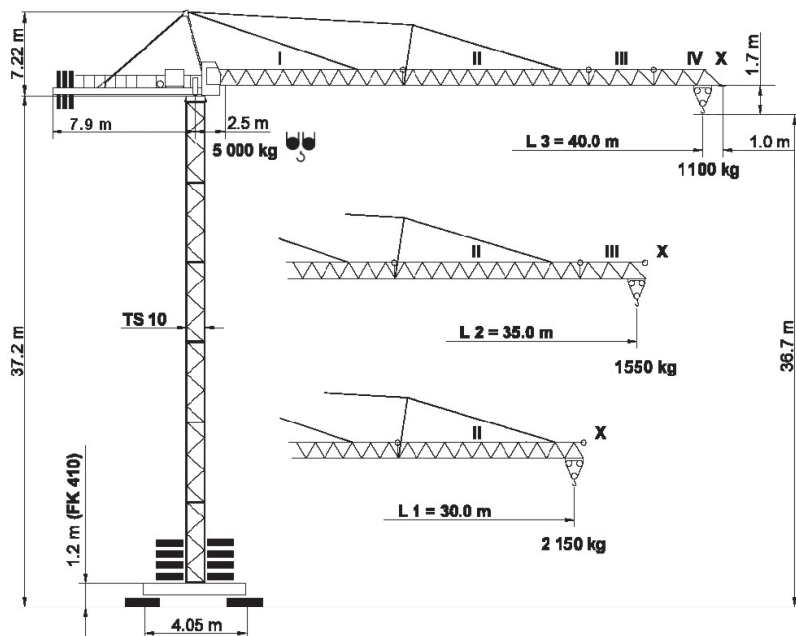


RODZAJE POSADOWIENIA


WERSJE STACJONARNE

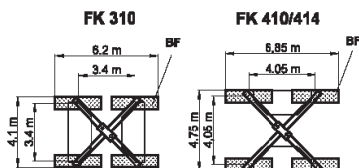

WERSJA PRZEJEZDNA



NA KOTWIE FUNDAMENTOWEJ



PEINER SK 56 Tabela udźwigów

Długości wysięgnika m	Udźwig maksymalny 5,0 t	Długość wysięgnika w [m] i udźwigi [t]															
																	
		12	14	16	18	20	22	24	26	28	30	32	34	35	36	38	40
L3 40,0	2.3-11.3m	4,63	3,86	3,30	2,88	2,54	2,27	2,05	1,87	1,71	1,57	1,45	1,35	1,30	1,26	1,17	1,10
L2 35,0	2.3-12.9m		4,53	3,88	3,38	2,99	2,68	2,42	2,21	2,02	1,86	1,73	1,61	1,55			
L1 30,0	2.3-14.4m			4,44	3,87	3,43	3,08	2,78	2,54	2,33	2,15						

Prędkości mechanizmów

PU S 4-50/2		$v =$	22 / 45 m / min.	Moc silników	2,4 kW			
SR 5-90/3		$v = 0 \rightarrow$	25 m / min.		2 x 5,0 kW			
K SRA 75/4		$v = 0 \rightarrow$	0,75 min ⁻¹		4,4 kW			
HK max. = 85 m 2 warstwy liny na bębnie					15,0 kW			
Typ PU 15/5			52 m / min	1 500 kg			26 m / min	3 000 kg
			26 m / min	2 500 kg			13 m / min	5 000 kg
			6 m / min				3 m / min	
400 V / 50 HZ / 3 PH Zapotrzebowanie na energię 50 kVA / Suma mocy silników PU 15/5 - 33 kW								


Balastowanie przeciwwagi

Długości wysięgnika		L 1	L 2	L 3	
Przeciwwaga	BG	3 x 3,15			
	[t]	9.450			

PEINER SK 56

Kombinacje wież, wysokości podnoszenia, naciski, balastowanie

WIEŻA TS 10

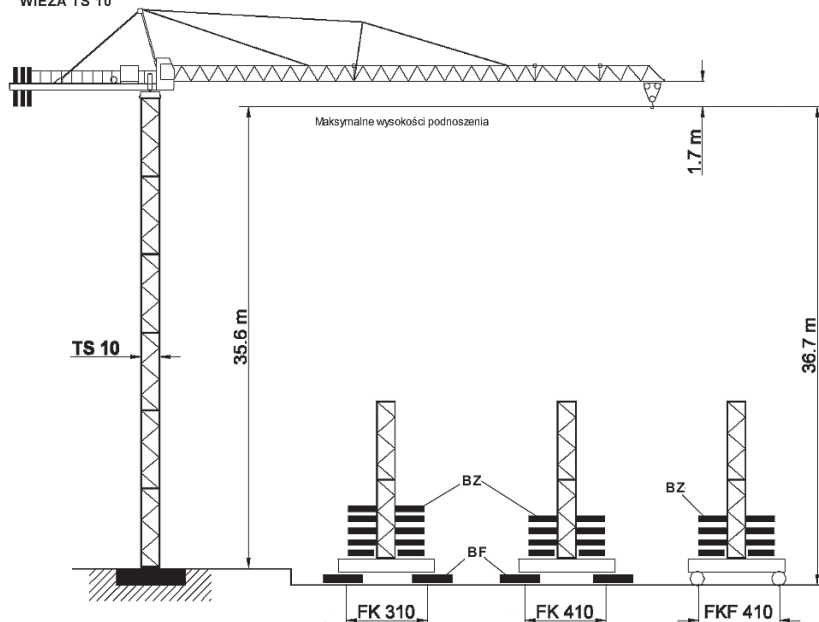

TS 10		Na kotwie	Stacjonarnie na krzyżu							Wersja przejezdna z jazdą torową				
Elementy wieży TS 10.3 TS 10.4		Wysokość podnoszenia	Wysokość podnoszenia	+ BZ BF t	Nacisk w pracy kN	Nacisk poza pracę kN	+ BZ BF t	Nacisk w pracy kN	Nacisk poza pracę kN	Elementy wieży TS 10.3 TS 10.4		BZ t	Nacisk w pracy kN	Nacisk poza pracę kN
6.0 m	12.0 m	m	m							6.0 m	12.0 m	t	kN	kN
6 x TS 10.3	3 x TS 10.4	35.6	36.7	60.8	392	437	40.8	319	359	6 x TS 10.3	3 x TS 10.4	40	341	371
5 x TS 10.3		29.6	30.7	40.8	320	316	30.8	275	270	5 x TS 10.3		30	293	278
4 x TS 10.3	2 x TS 10.4	23.6	24.7	30.8	276	230	30.8	259	217	4 x TS 10.3	2 x TS 10.4	30	274	225
3 x TS 10.3		17.6	18.7	30.8	259	223	20.8	219	186	3 x TS 10.3		30	257	214
2 x TS 10.3	1 x TS 10.4	11.6	12.7	30.8	244	219	20.8	205	182	2 x TS 10.3	1 x TS 10.4	20	216	186
1 x TS 10.3		5.6	6.7	30.8	231	216	20.8	194	179	1 x TS 10.3		20	202	182
Fundament			Podstawa krzyżowa stacjonarna							Podstawa krzyżowa z jazdą torową				
5.0 x 5.0 x 1.2 m			FK 310 FK 410							FKF 414				
Kotwa tracona 4 x FF 10/14			Rodzaje balastów BF-bloki fundamentowe; BZ-balasty centralne							wózki jezdne jazda na wprost F 40/1				
			BZ 4 x 2.7 t	BZ Block 5.0 t	BZ 4 x 2.7 t	BZ Block 5.0 t								

TS 10.3 = 6.0 m

TS 10.4 = 12.0 m